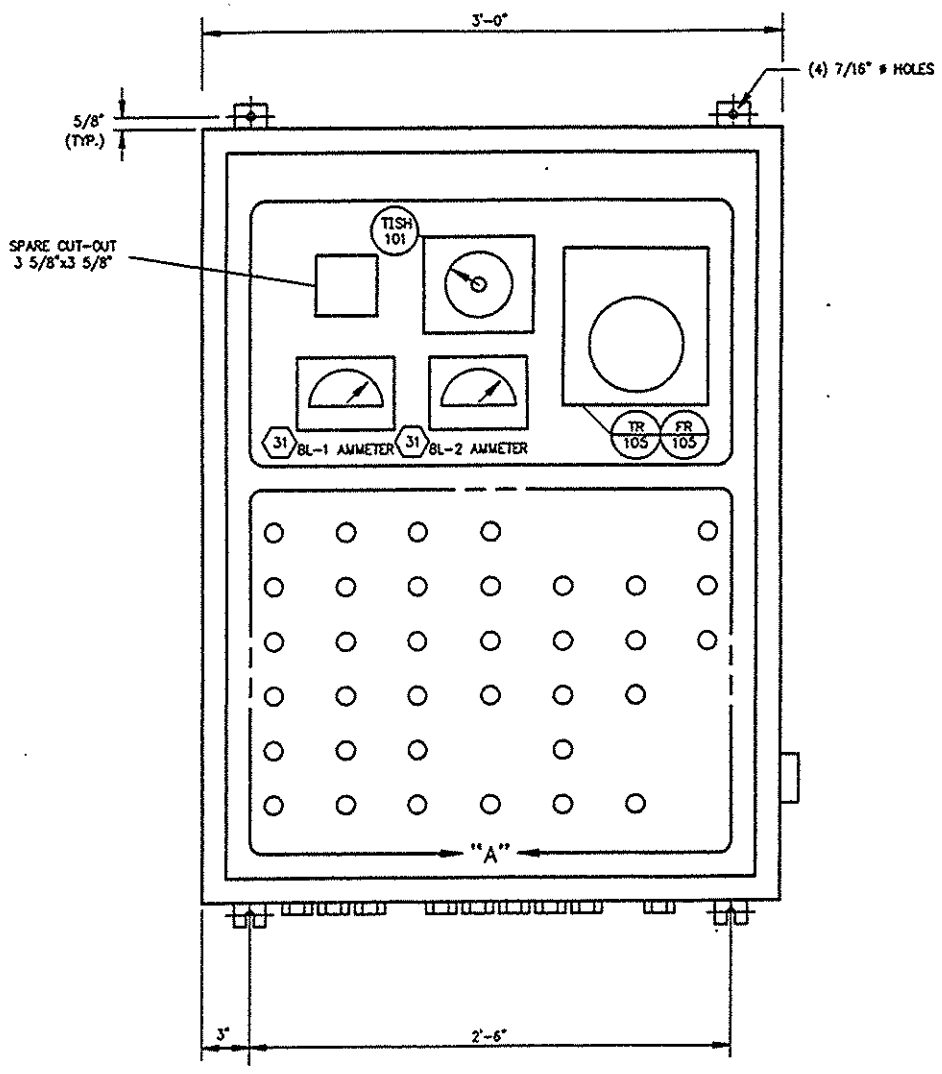

FRONT VIEW
PNL-101

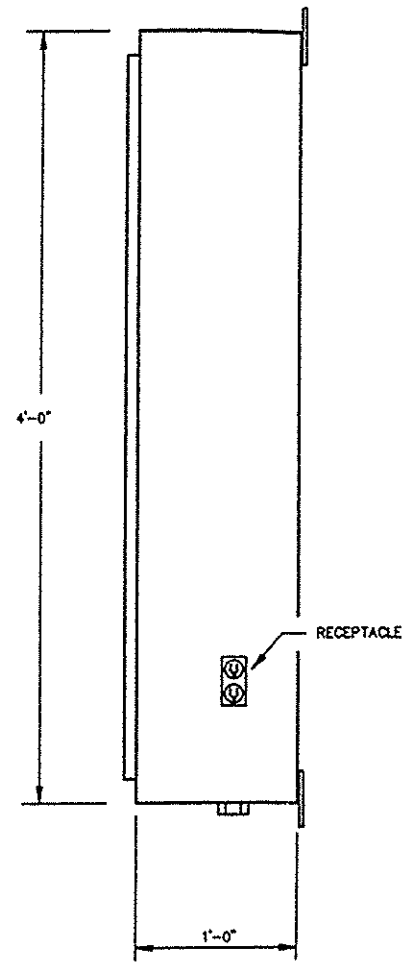

SIDE VIEW

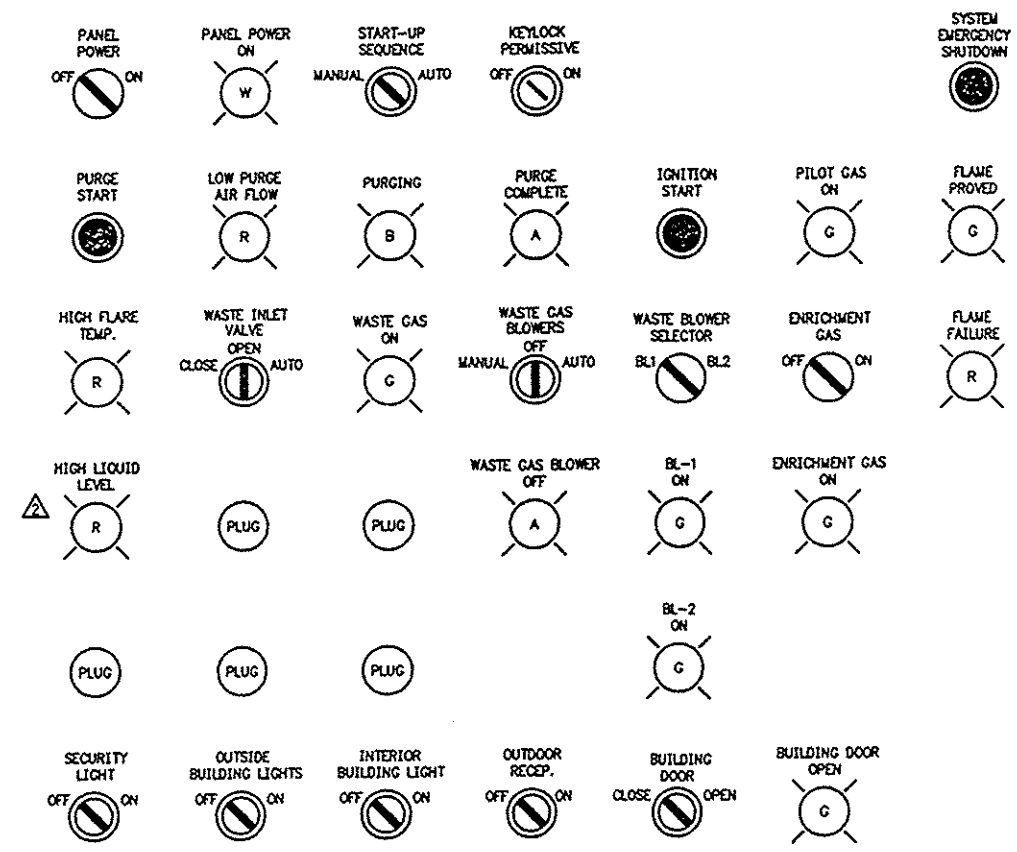

DETAIL "A"

CONFIDENTIAL

REVISED

SHOP CODE ~ 446

Notes :

1. AREA CLASSIFICATION ~ NON HAZARDOUS, ENCLOSURE IS NEMA 4
2. CUSTOMER TO USE ONE CONDUIT CONNECTION FOR EACH TYPE CIRCUIT AS FOLLOWS :
   A. U.V. FLAME SENSOR & 120 VAC CONTROL (3/4" CONN.)
   B. THERMOCOUPLE (3/4" CONN.)
   C. SPARK IGNITOR (3/4" CONN.)
   D. FIELD 120V CONTROL (3/4" CONN.)

No.	Date	By	Chk'd	App'd	Description
2	6-10-91	LKS			REVISED PER ECN 5362
1	3-28-91	CLARK	SC	JRH	ADDED 2 CUSTOMER CONN.'S TO PNL-101 PER ECN No. 4833

Revisions

Dwg. No.	Subject

Reference Drawings

This drawing is the property of and intended only for the private use of IT-McGILL Pollution Control Systems and may not be reproduced or given to third parties without prior written consent.

Drawn	GANDEE
Date	10-09-90
Scale	NONE
Checked	SC
App'd	JRH

Customer: BROWNING FERRIS IND.

ELECTRICAL
CONTROL PANEL ASSEMBLY

IT McGill — Pollution Control Systems, Tulsa, Oklahoma

P.O. No. 9539

Revision No. 2

Drawing No. D-120575-60-101

Sheet 1 of 1